



Longfield Solar Farm

Works Plans Part 2 of 2

Document Reference : EN010118/APP/2.2(B)

Deadline 3

Revision 3.0


October 2022

Longfield Solar Energy Farm Ltd

Works Plans Part 2 of 2 – Revisions Schedule

| Drawing Title | Revision | Drawing Number | Reason for Revision |
|-------------------------|----------|--------------------------|--|
| Works Plan Key Plan | I | 4077-LGF-DR-PRE-0008.0_I | No change made. |
| Works Plan Sheet 1 of 9 | I | 4077-LGF-DR-PRE-0008.1_I | No change made. |
| Works Plan Sheet 2 of 9 | I | 4077-LGF-DR-PRE-0008.2_I | Shows work no.4b hatching which was included on revision 1.0, but through error omitted from revision 2.0 submitted at Deadline 2. |
| Works Plan Sheet 3 of 9 | I | 4077-LGF-DR-PRE-0008.3_I | Shows work no.4b hatching which was included on revision 1.0, but through error omitted from revision 2.0 submitted at Deadline 2. |
| Works Plan Sheet 4 of 9 | I | 4077-LGF-DR-PRE-0008.4_I | No change made. |
| Works Plan Sheet 5 of 9 | I | 4077-LGF-DR-PRE-0008.5_I | No change made. |
| Works Plan Sheet 6 of 9 | I | 4077-LGF-DR-PRE-0008.6_I | No change made. |
| Works Plan Sheet 7 of 9 | I | 4077-LGF-DR-PRE-0008.7_I | No change made. |
| Works Plan Sheet 8 of 9 | I | 4077-LGF-DR-PRE-0008.8_I | No change made. |
| Works Plan Sheet 9 of 9 | I | 4077-LGF-DR-PRE-0008.9_I | No change made. |

- KEY
- Order Limits
 - Work No. 1
 - Work No. 6
 - Work No. 7A
 - Work No. 8
 - Work No. 9
 - Work No. 10
 - Districts of Chelmsford and Braintree

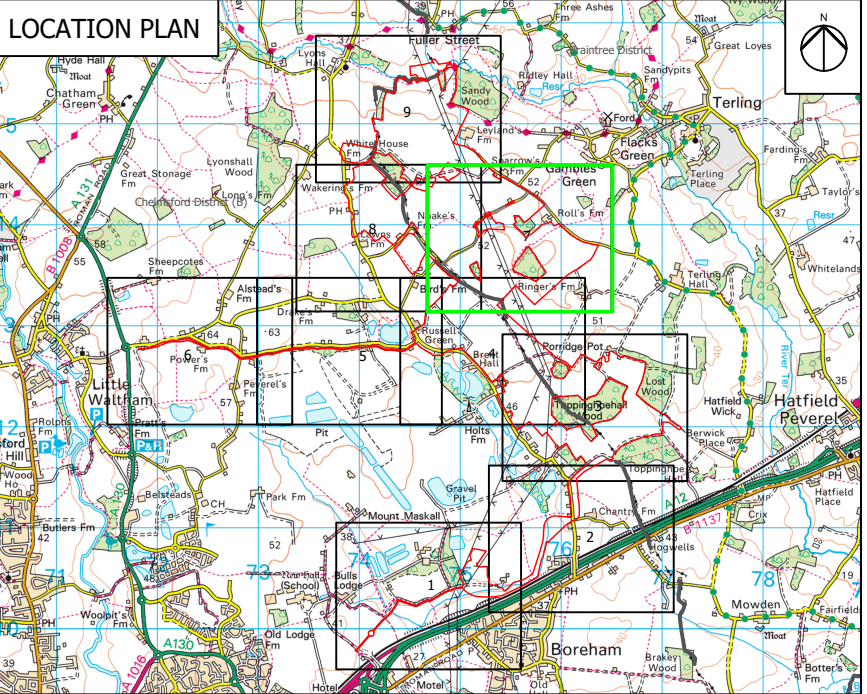

THIS DRAWING HAS BEEN PREPARED IN ACCORDANCE WITH THE SCOPE OF ARCUS' APPOINTMENT WITH ITS CLIENT AND IS SUBJECT TO THE TERMS OF THAT APPOINTMENT. ARCUS ACCEPTS NO LIABILITY FOR ANY USE OF THIS DOCUMENT OTHER THAN BY ITS CLIENT AND ONLY FOR THE PURPOSES FOR WHICH IT WAS PREPARED AND PROVIDED.

NOTES:

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DOCUMENTATION.
2. WORKS PLAN IN ACCORDANCE WITH REGULATION 3(2)(3) OF THE INFRASTRUCTURE PLANNING APPLICATIONS: PRESCRIBED FORMS AND PROCEDURES REGULATIONS 2009.
3. ALL DIMENSIONS, CHANGES, LEVELS AND COORDINATES ARE IN METRES UNLESS OTHERWISE SPECIFIED.
4. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE PROJECT HEALTH & SAFETY FILE FOR ANY IDENTIFIED POTENTIAL RISKS.
5. THE DRAWING IS THE PROPERTY OF ARCUS AND CANNOT BE REPRODUCED IN ANY FORM WITHOUT THE EXPRESS CONSENT OF THE COMPANY. WRITTEN AND SCALED CORRECTIONS TO BE CHECKED ON SITE, AND ANY DISCREPANCIES SHOULD BE REPORTED TO ARCUS PRIOR TO WORK COMMENCING ON SITE.

THE SOLAR PV ARRAYS IN WORK NUMBER 1 WILL BE LOCATED ACROSS 20 POTENTIAL DEVELOPABLE AREAS (PDAs). THE PARAMETERS FOR THE PDAs AND THE DESIGN PRINCIPLES THAT APPLY TO THEM ARE SET OUT IN THE OUTLINE DESIGN PRINCIPLES (END001) (BAP07/23).

50 25 0 50 100 150 m

STATUS: **DCO Application**

BASE: Reproduced from Ordnance Survey digital map data © Crown copyright 2022. All rights reserved. Licence number 100048606

GRID REFERENCE: SP 966403

PROJECT: Longfield Solar Farm

TITLE: Works Plan Sheet 7

CLIENT: Longfield Solar Energy Farm Ltd


DATE: 15.09.22 SCALE: 1:2,500@A1



DRAWN: EL DRAWING NO.: 4077_LGF_DR_PRE_0008.7

CHECKED: RS REVISION: I

ARCUS

Arcus Consultancy Services
1C Swinegate Court East
3 Swinegate
York, YO1 8AJ
tel: +44 (0)1904 715 470
www.arcusconsulting.co.uk

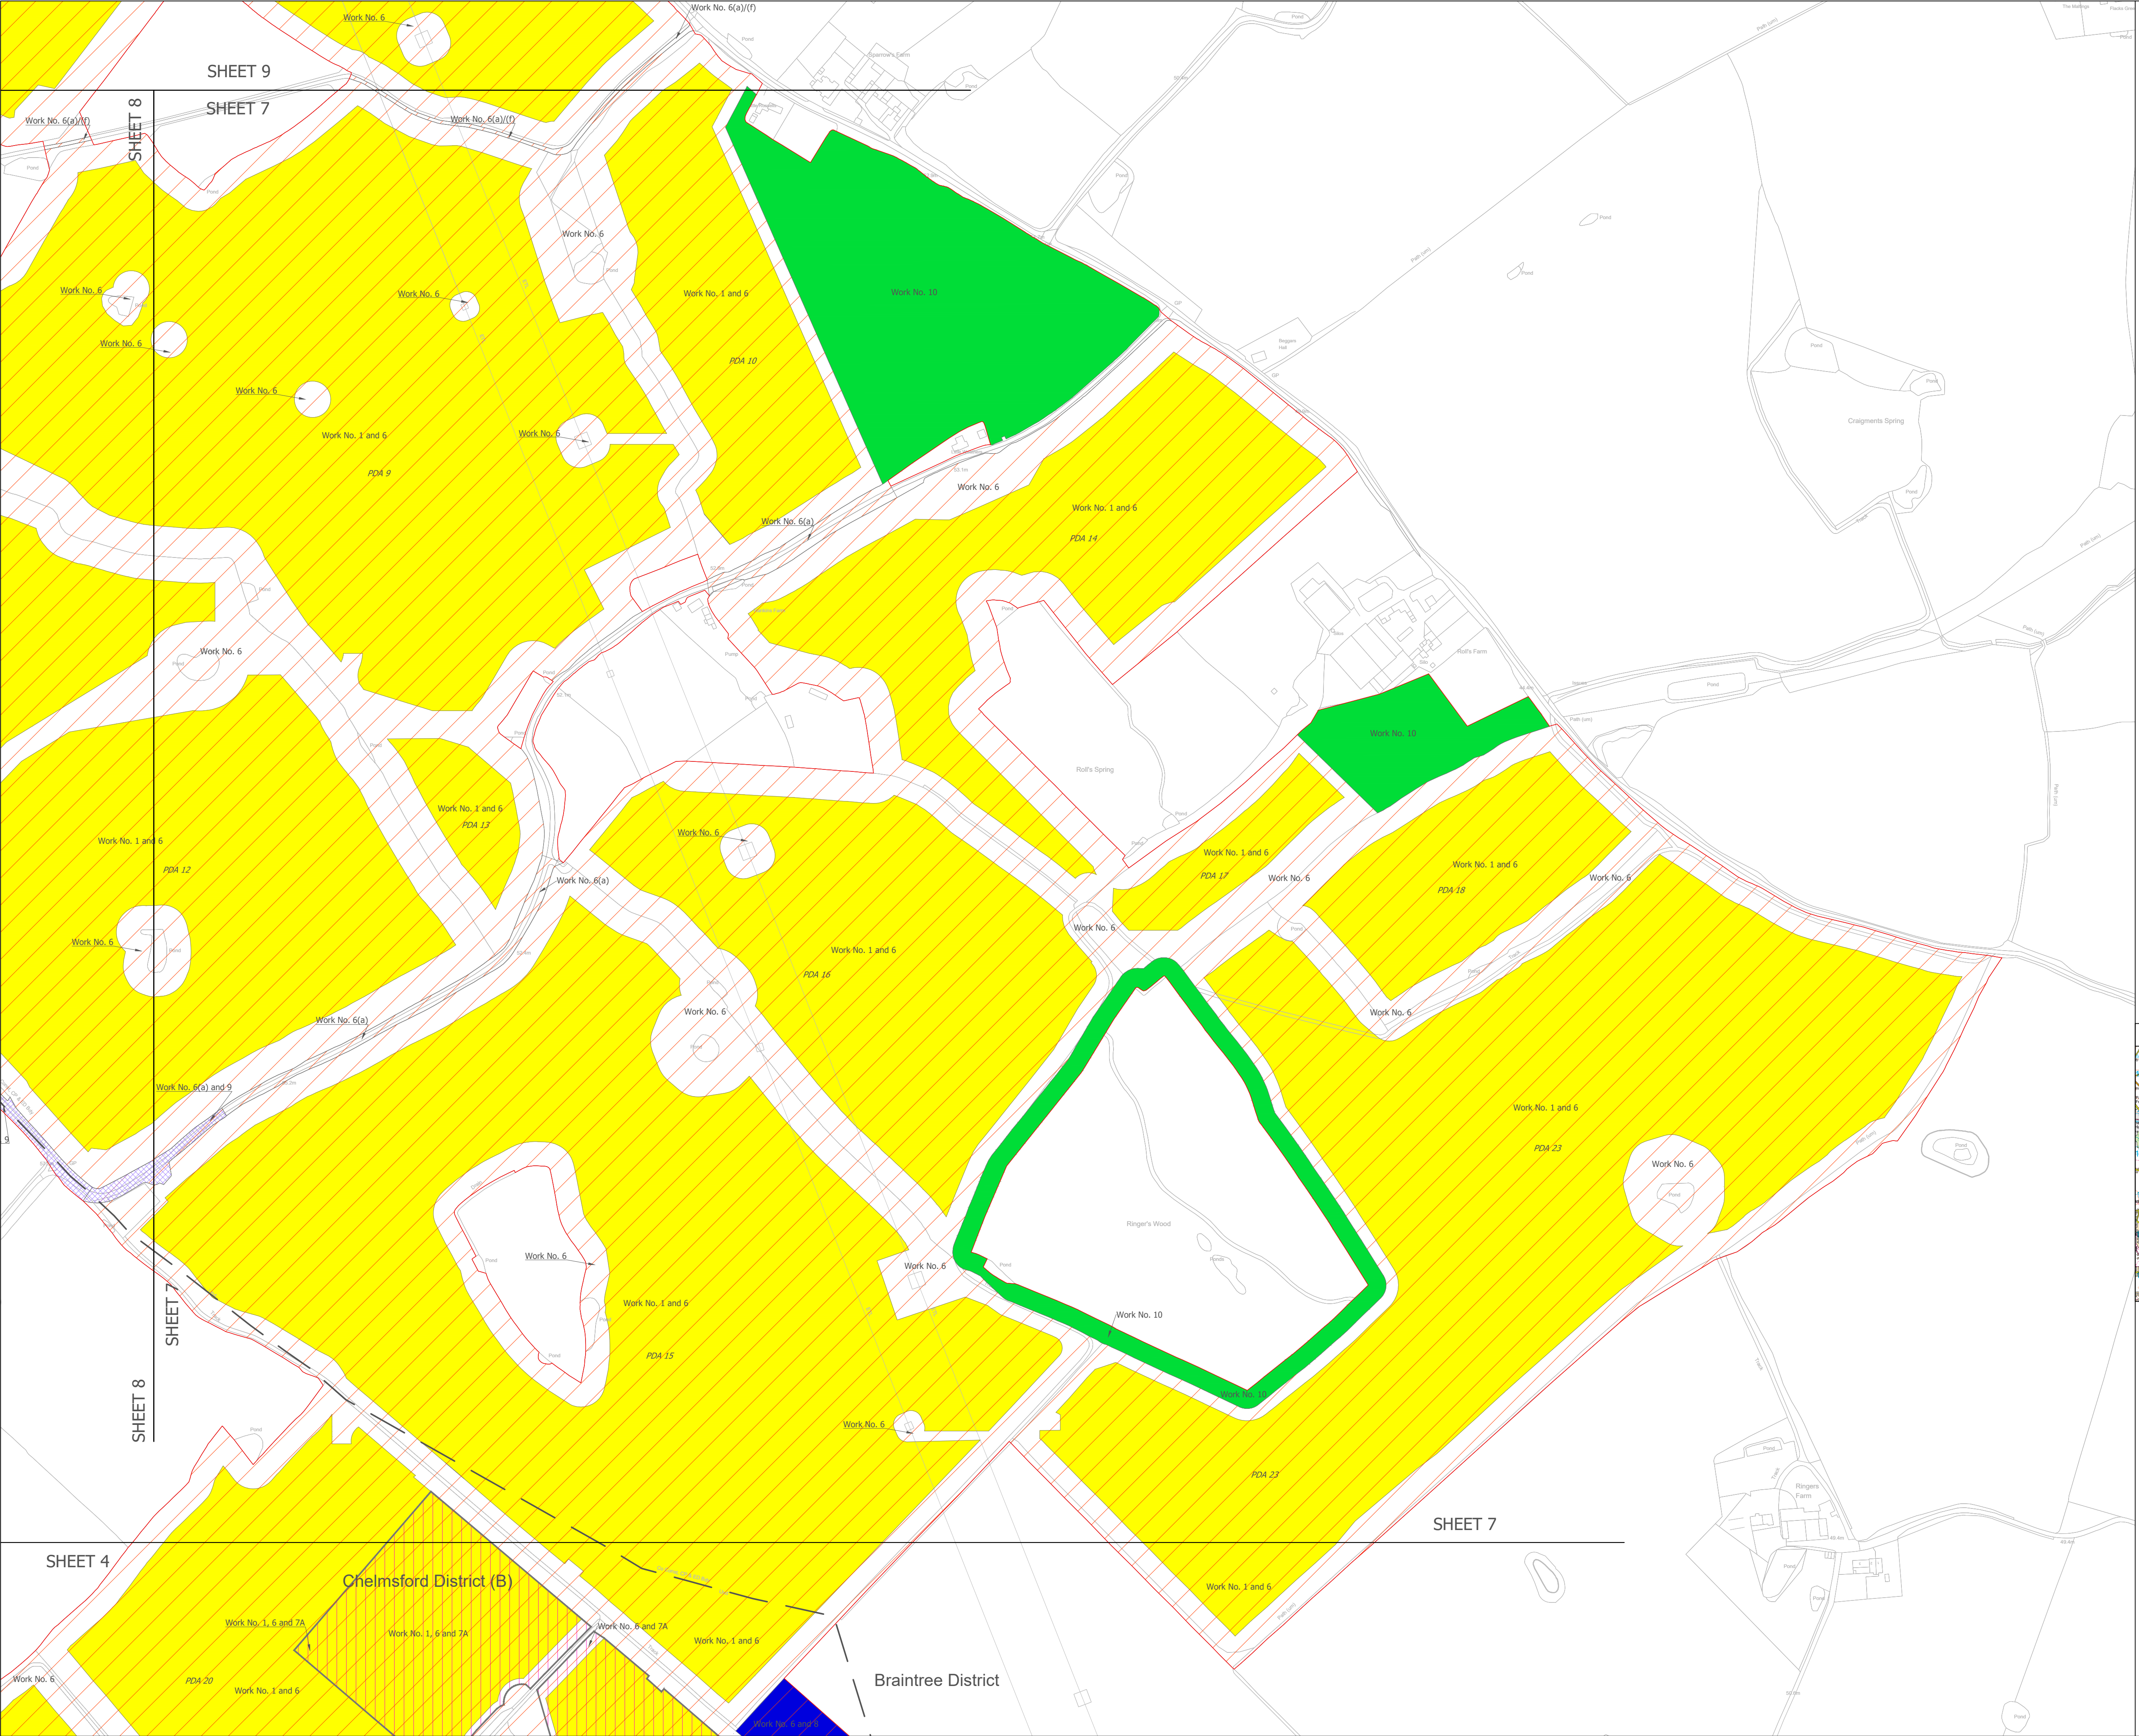


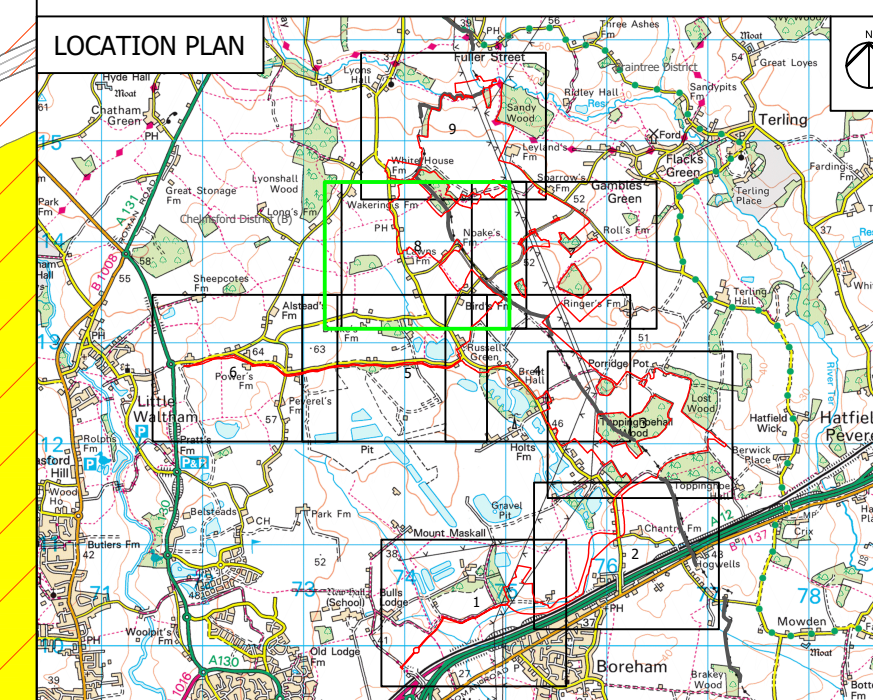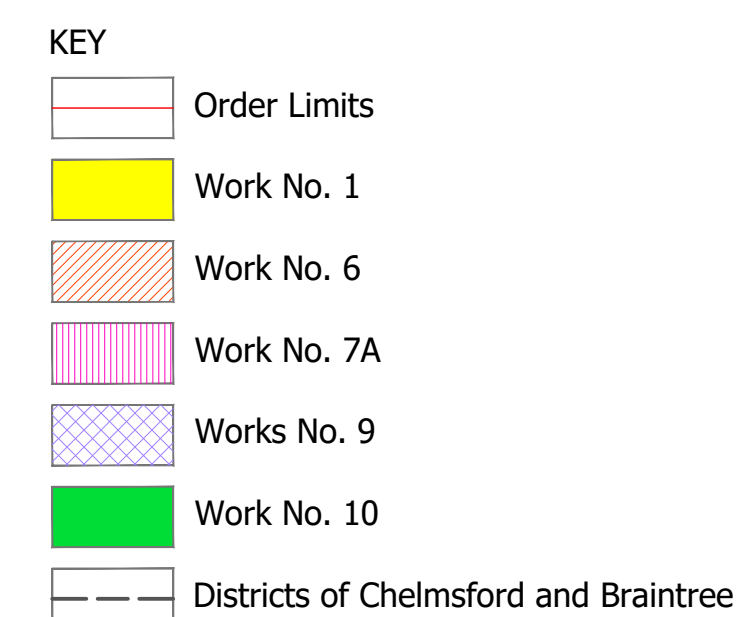

THIS DRAWING HAS BEEN PREPARED IN ACCORDANCE WITH THE SCOPE OF ARCS' APPOINTMENT WITH ITS CLIENT AND IS SUBJECT TO THE TERMS OF THAT APPOINTMENT. ARCS ACCEPTS NO LIABILITY FOR ANY USE OF THIS DOCUMENT OTHER THAN BY ITS CLIENT AND ONLY FOR THE PURPOSES FOR WHICH IT WAS PREPARED AND PROVIDED.

NOTES

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DOCUMENTATION.
2. WORKS PLAN IN ACCORDANCE WITH REGULATION 5(2)(3) OF THE INFRASTRUCTURE PLANNING (APPLICATIONS, PRESCRIBED FORMS AND PROCEDURE) REGULATIONS 2009.
3. DIMENSIONS, CHANGES, LEVELS AND COORDINATES ARE IN METRES UNLESS DEFINED OTHERWISE.
4. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE PROJECT HEALTH & SAFETY FILE FOR ANY IDENTIFIED POTENTIAL HAZARD.
5. THE DRAWING IS THE COPYRIGHT OF ARCUS AND CANNOT BE REPRODUCED IN ANY FORM WITHOUT THE EXPRESS CONSENT OF THE COMPANY. WRITTEN AND SCALED DIMENSIONS TO BE CHECKED ON SITE, AND ANY DISCREPANCIES SHOULD BE REPORTED TO ARCUS PRIOR TO WORK COMMENCING ON SITE.
- THE SOLAR PV ARRAYS IN WORK NUMBER 1 WILL BE LOCATED ACROSS THE FOLLOWING DESIGNATED AREAS (DPA). THE PARAMETERS FOR THE DESIGN OF THE SOLAR PV AREAS ARE SET OUT IN TABLE 1 OF THE DESIGN DEVELOPMENT REPORT (DDR).



STATUS: **DCO Application**

BASE: Reproduced from Ordnance Survey digital map data © Crown copyright 2022. All rights reserved. Licence number 100048606


GRID REFERENCE: SP 96640.

| | |
|--------------|-------------------------------------|
| PROJECT: | Longfield Solar Farm |
| TITLE: | Works Plan Sheet 8 |
| CLIENT: | Longfield Solar Energy Farm Limited |
| DATE: | 15.09.22 |
| SCALE: | 1:2,500@A1 |
| DRAWN: | EL |
| CHECKED: | RS |
| DRAWING NO.: | I077_LGF_DR_PRR_0008.8 |
| REVISION: | 4 |




ARCUS

Arcus Consultancy Services
1C Swinegate Court East
3 Swinegate
York, YO1 8AJ
tel: +44 (0)1904 715 470
www.arcusconsulting.co.uk

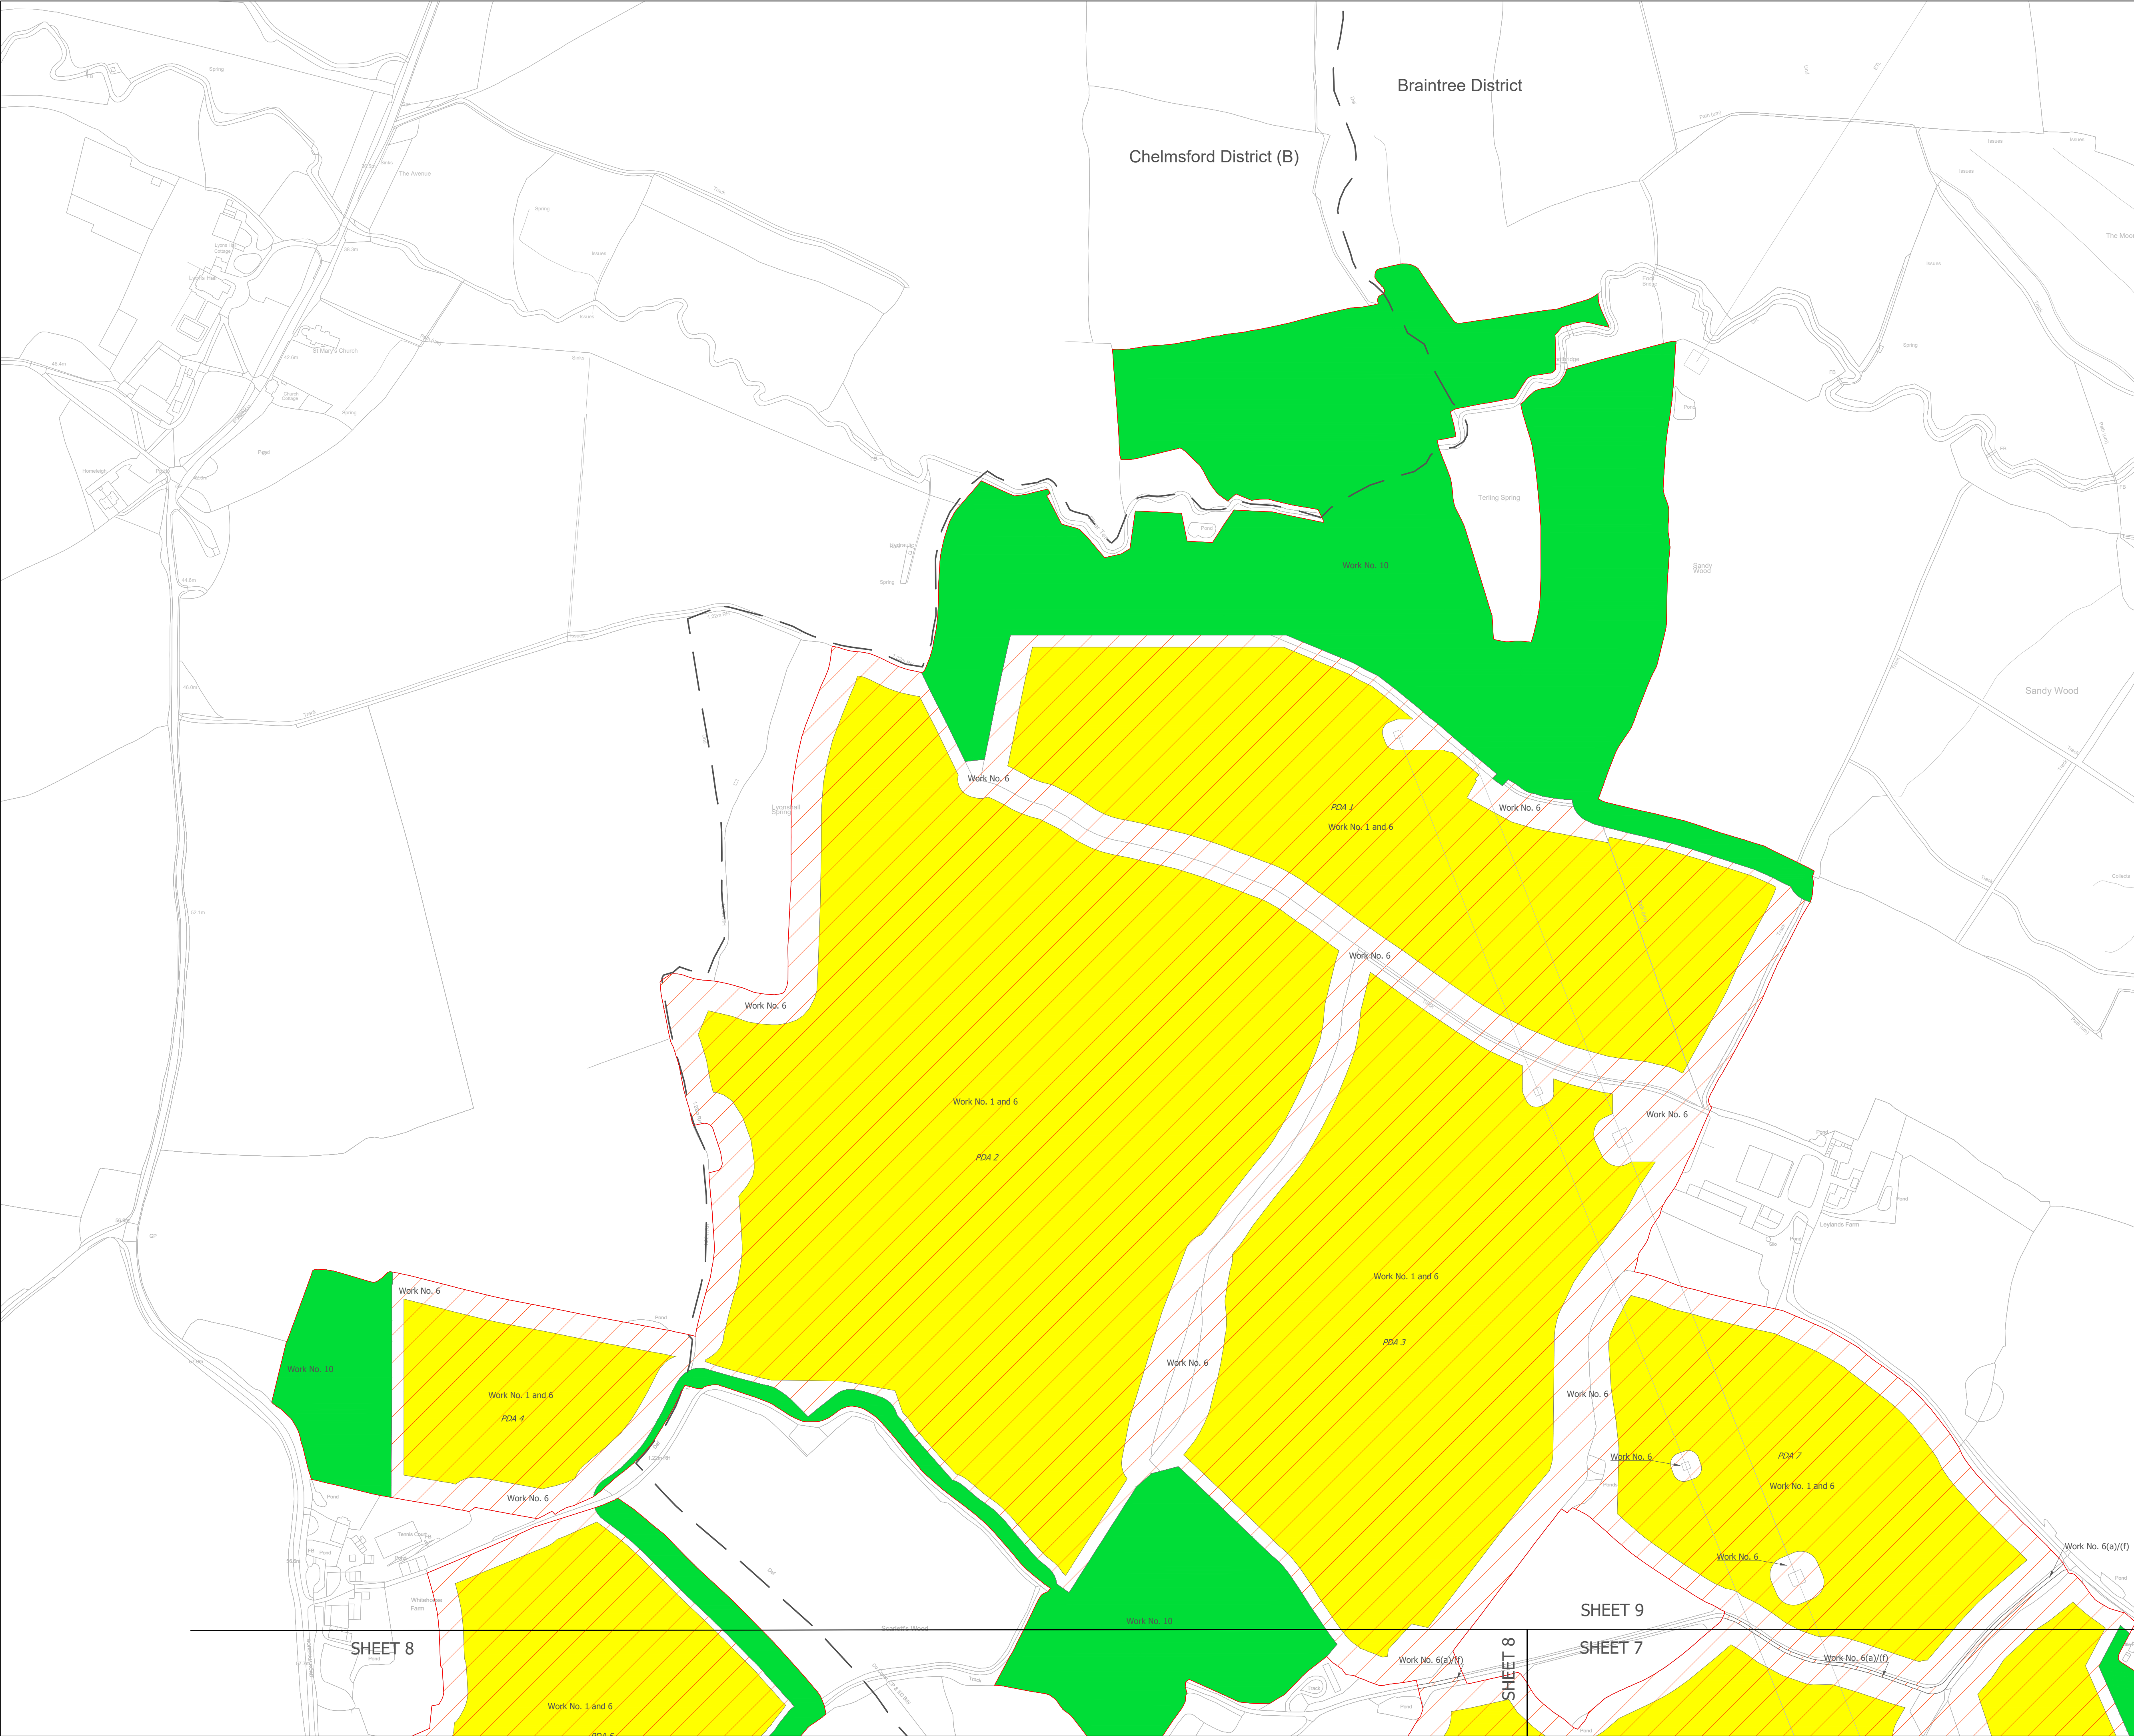

- KEY
- Order Limits
 - Work No. 1
 - Work No. 6
 - Work No. 10
 - Districts of Chelmsford and Braintree

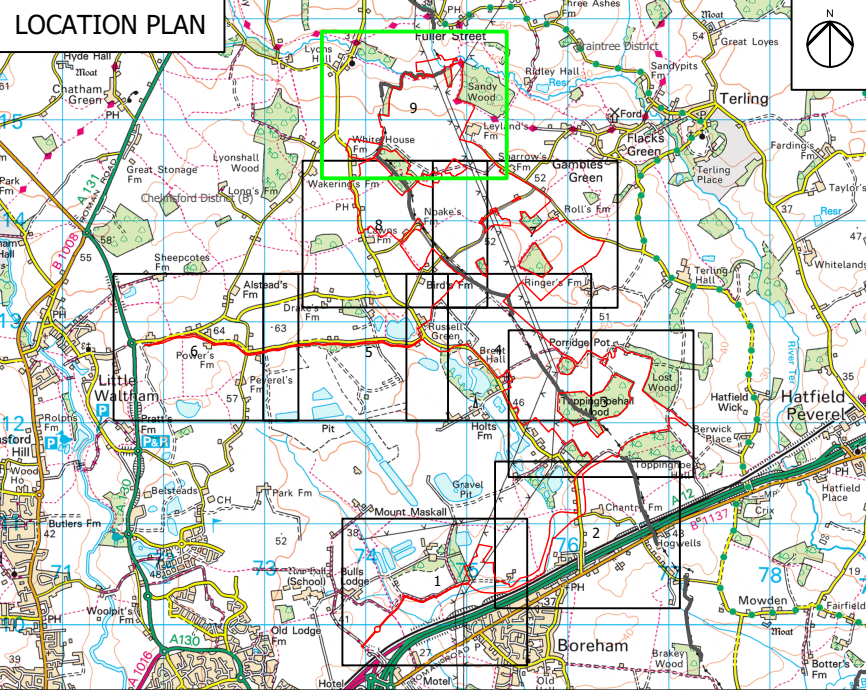

THIS DRAWING HAS BEEN PREPARED IN ACCORDANCE WITH THE SCOPE OF ARCUS' APPOINTMENT WITH ITS CLIENT AND IS SUBJECT TO THE TERMS OF THAT APPOINTMENT. ARCUS ACCEPTS NO LIABILITY FOR ANY USE OF THIS DOCUMENT OTHER THAN BY ITS CLIENT AND ONLY FOR THE PURPOSES FOR WHICH IT WAS PREPARED AND PROVIDED.

NOTES:

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DOCUMENTATION.
2. WORKS PLAN IN ACCORDANCE WITH REGULATION 3(2)(C) OF THE INFRASTRUCTURE PLANNING APPLICATIONS: PRESCRIBED FORMS AND PROCEDURAL REGULATIONS 2009.
3. ALL DIMENSIONS, CHANGES, LEVELS AND COORDINATES ARE IN METRES UNLESS DEFINED OTHERWISE.
4. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE PROJECT HEALTH & SAFETY FILE FOR ANY IDENTIFIED POTENTIAL RISKS.
5. THIS DRAWING IS THE COPYRIGHT OF ARCUS AND CANNOT BE REPRODUCED IN ANY FORM WITHOUT THE EXPRESS CONSENT OF THE COMPANY. WRITTEN AND SCALED CORRECTIONS TO BE CHECKED ON SITE, AND ANY DISCREPANCIES SHOULD BE REPORTED TO ARCUS PRIOR TO WORK COMMENCING ON SITE.
6. THE SOLAR PV ARRAYS IN WORK NUMBER 1 WILL BE LOCATED ACROSS 20 POTENTIAL DEVELOPABLE AREAS (PDAs). THE PARAMETERS FOR THE PDAs AND THE DESIGN PRINCIPLES THAT APPLY TO THEM ARE SET OUT IN THE OUTLINE DESIGN PRINCIPLES (EN010118/APP7.2).

50 25 0 50 100 150 m

STATUS: **DCO Application**

BASE: Reproduced from Ordnance Survey digital map data © Crown copyright 2022. All rights reserved. Licence number 100048606

GRID REFERENCE: SP 966403

PROJECT: Longfield Solar Farm
TITLE: Works Plan Sheet 9
CLIENT: Longfield Solar Energy Farm Limited
DATE: 15.09.22 SCALE: 1:2,500@A1
DRAWN: EL DRAWING NO.: 4077_LGF_DR_PRE_0008.9
CHECKED: RS REVISION: I

ARCUS
Arcus Consultancy Services
1C Swinegate Court East
3 Swinegate
York, YO1 8AJ
tel: +44 (0)1904 715 470
www.arcusconsulting.co.uk